

COUNTY OF VENTURA
DEPARTMENT OF AIRPORTS

November 09, 2012

ADDENDUM No. 1

From: Todd McNamee, Director of Airports
To: All Prospective Bidders

Subject: Project Name: **Camarillo Airport -
295 DURLEY AVENUE BUILDING IMPROVEMENTS**

Specification No: **DOA 13-02**
Project No: **CMA-185**

Bid Opening Date: **TUESDAY, November 20, 2012 ORIGINAL DATE**

Make the following modification to the bidding documents for subject project:

Note: As a result of Building & Safety, Plan Check and Pre-Bid Conference comments, the PLAN SHEET A2.2 has been modified. The following are modifications to the PLANS:

BID ITEM No. 1:

1. PLAN SHEET A2.2 – DETAIL 1, Demolition - Restrooms “Add NOTE 17”.
2. PLAN SHEET A2.2 – DETAIL 2, Proposed – Restrooms “Add NOTES 27 & 28”.
3. PLAN SHEET A2.2 – DETAIL 4, Proposed – Break Room “Revise NOTE 16”.

BID ITEM No.2:

1. PLAN SHEET A2.2 – DETAIL 3, Proposed – Bait Room “Add NOTES 29 & 30”.

NOTE: Reflect the costs for the changes under the appropriate BID ITEM!

Approved: _____



Todd McNamee, Director of Airports

ATTACHMENT: PLAN SHEET A2.2, Revised



1. EXISTING WATER CLOSETS TO BE REMOVED.
2. EXISTING URINAL TO BE REMOVED.
3. EXISTING WALL MOUNT SINK TO BE RELOCATED.
4. EXISTING TOILET PARTITIONS, PRIVACY SCREENS TO BE REMOVED.
5. EXISTING GRAB BARS, TOILET ACCESSORIES, SOAP DISPENSERS TO BE RELOCATED.
6. IMMEDIATE TILED AREA AT FLOOR DRAIN TO BE REMOVED TO RAISE EXISTING FLOOR DRAIN.
7. EXISTING SHOWER GRAB BARS, SEAT, SHOWER HEAD, FLOOR DRAIN, ALL EXISTING TILED WALL FINISHES TO REMAIN.
8. EXISTING BASE CABINET TO BE REMOVED.
9. EXISTING BASE CABINET, COUNTER MOUNT SINK TO BE REMOVED.
10. EXISTING COUNTER TO BE REMOVED.
11. EXISTING WALL MIRROR TO BE RELOCATED.
12. EXISTING DOOR TO BE REMOVED, REINSTALLED.
13. EXISTING DOOR TO BE REMOVED. FRAME TO REMAIN.
14. EXISTING URINAL TO REMAIN
15. EXISTING WALL MOUNT SINK TO BE RELOCATED TO "WOMENS".
16. REMOVE EXISTING FLOOR TILE, SAWCUT EXISTING CONCRETE SLAB FOR INSTALLATION OF TRAP PRIMER. SEE PLUMBING DRAWINGS.
17. REMOVE EXISTING DOOR AND ALUMINUM DOOR FRAME, WALL FRAMING AS REQUIRED TO PROVIDE MINIMUM 18" CLEARANCE ON STRIKE SIDE OF DOOR SEE PROPOSED PLANS.

1. FUME HOOD. SEE MECHANICAL DRAWINGS.
2. NEW WALL MOUNTED SINK, ACCESSIBLE CONTROLS, INSULATED HOT WATER AND DRAIN LINES.
3. EMERGENCY WASH OFF SHOWER AND FLOOR DRAIN. SEE PLUMBING DRAWINGS.
4. NEW FLOOR MOUNT WATER CLOSET.
5. NEW ACCESSIBLE URINAL.
6. EXISTING FLOOR DRAIN TO REMAIN.
7. RELOCATED TOILET SEAT DISPENSER AND TOILET PAPER DISPENSER. TYPICAL AT TOILET STALLS. SEE DETAIL FOR TYPICAL MOUNTING HEIGHTS, LOCATIONS.

8. REPLACEMENT METAL TOILET PARTITIONS, DOORS AND URINAL PANELS.
9. RELOCATED 36" LONG 1-1/2" O.D. GRAB BAR MOUNTED 1-1/2" FROM WALL 33" A.F.F. TYP.
10. RELOCATED 42" LONG 1-1/2" O.D. GRAB BAR MOUNTED 1-1/2" FROM WALL A 33" A.F.F. TYP.
11. 3'-0" WIDE METAL COMPARTMENT DOOR WITH SELF CLOSER, U-SHAPED HANDLE OR LOOP TO OPERATE THE DOOR, MAXIMUM PRESSURE TO OPERATE THE DOOR DOES NOT EXCEED 5 LBF.
12. EXISTING DRAIN LOCATION. RAISE DRAIN TO 1/4" BELOW FINISHED FLOOR PATCH, REPAIR FLOOR AS REQUIRED.
13. EXISTING SHOWER GRAB BARS, SEAT, SHOWER HEAD TO REMAIN.
14. REINSTALLED EXISTING STONE COUNTER TOP AND SPLASH.
15. REMOVE EXISTING OAK WOOD BASE CABINET. PROVIDE ACCESSIBLE OAK WOOD BASE CABINET TO MATCH EXISTING. INSTALL OWNERS UPPER CABINET.

- 16) EXISTING COUNTER MOUNT SINK TO BE REPLACED. PROVIDE REPLACEMENT STAINLESS STEEL COUNTER MOUNT SINK, APPROXIMATE 32"x22"x1" DEEP SINGLE HOLE. REPLACEMENT SINK DRAIN AND REINSTALLED GARBAGE DISPOSAL TO BE LOCATED TO ALLOW ACCESSIBLE KNEE CLEARANCE F. DETAIL 3/A3.3.

- 17 CLEAR 30" X 48" AREA. TYP.
- 18 CLEAR 5'-0" RADIUS AREA. TYP.
- 19 EXISTING URINAL..
- 20 RELOCATED WALL MOUNT SINK, ACCESSIBLE CONTROLS, INSULATED HOT WATER AND DRAIN LINES.
21. UTILITY SINK WITH ACCESSIBLE CONTROLS.

22. APPROXIMATE 3'-0" X 3'-0" AREA OF EXISTING CONCRETE FLOOR TO BE REMOVED. PROVIDE REPLACEMENT CONCRETE SUBFLOOR, SLOPE 2% TO NEW DRAIN. TIE REPLACEMENT SUBFLOOR TO EXISTING.
23. SURFACE MOUNT SOAP DISPENSER.
24. SURFACE MOUNT PAPER TOWEL AND TRASH RECEPTACLE.


26. FOLDING STAINLESS STEEL UTILITY SHELF ALL ALL TOILET STALLS. TYP.


- 27) REINSTALL EXISTING DOOR, ALUMINUM DOOR FRAME TO PROVIDE MINIMUM 18" CLEARANCE ON STRIKE SIDE OF DOOR. REPLACEMENT WOOD TRIM MAY BE SUBSTITUTED FOR THE EXISTING ALUMINUM SNAP ON CASING IF THE RELOCATED DOOR FRAME DOES NOT ALLOW CLEARANCE FOR REINSTALLATION OF THE EXISTING ALUMINUM CASING. REPLACEMENT WOOD CASING TO BE PAINTED. PATCH AND REPAIR FLOOR FINISH, ADJACENT WALL SURFACES AS REQUIRED.

- 28) WALL FRAMING AT STRIKE SIDE OF DOOR TO PROVIDE MINIMUM 18" WALL CLEARANCE AT STRIKE SIDE OF DOOR.

- 30 REMOVE AND REINSTALL PORTION OF THE EXISTING GALVANIZED CHAIN LINK FENCE AND POST TO PROVIDE MINIMUM 2'-0" CLEARANCE ON STRIKE SIDE DOOR TO 5'-0" FROM DOOR.

SPEC. NUMBER DOA-13-02	PROJECT: 295 DURLEY
PROJECT NUMBER CMA-185	DRAWING NUMBER 913-DOA

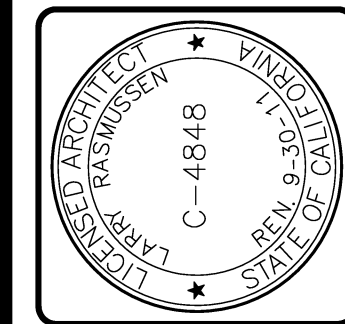

<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;">  </div> <div> <p>Revisions</p> <p>1 11-6-12</p> </div> </div>	R&A No:	A08050.3
	Date:	11-06-12
	Drawn:	R&A
	Checked:	J.H.
	Consult. No:	